


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

GENERAL NOTES:


ALL UTILITY PIPE SHALL BE INSTALLED WITH 3 INCH WIDE SELF ADHESIVE VINYL CONTINUOUS TAPE, FOR IDENTIFICATION PURPOSES. TAPE SHALL BE COLOR CODED AND WORDED AS FOLLOWS:

1. POTABLE WATER.
 - A. COLOR: BLUE WITH BLACK OR WHITE LETTERING
 - B. LETTERING: POTABLE WATER MAIN OR SIMILAR WORDING.
2. RECLAIMED WATER.
 - A. COLOR: PURPLE WITH WHITE OR YELLOW LETTERING.
 - B. LETTERING: RECLAIMED WATER MAIN OR SIMILAR WORDING.
3. FIRE LINES.
 - A. COLOR: RED WITH BLACK OR WHITE LETTERING
 - B. LETTERING: FIRE LINE OR SIMILAR WORDING.
4. GRAVITY SEWER.
 - A. COLOR: BROWN OR GREEN WITH BLACK OR WHITE LETTERING.
 - B. LETTERING: SEWER LINE OR SIMILAR WORDING.
5. SEWER FORCE MAIN.
 - A. COLOR: GREEN WITH BLACK OR WHITE LETTERING.
 - B. LETTERING: SEWER FORCE MAIN OR SIMILAR WORDING.



2 1/2" - 4" PIPE - 3" TAPE IS CENTERED ALONG TOP HALF OF PIPE.

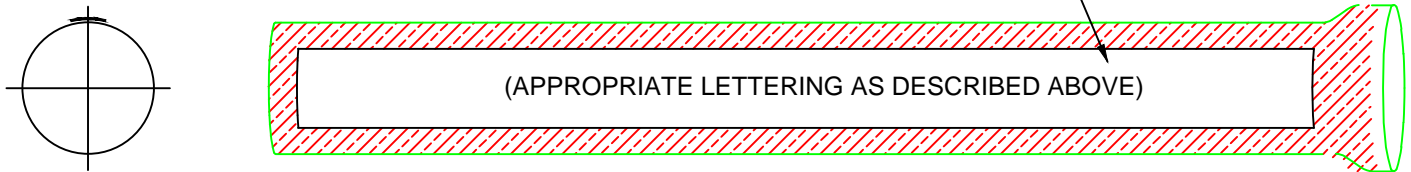

6" - 16" PIPE - 6" MIN TAPE IS PLACED ALONG BOTH SIDES OF TOP HALF OF PIPE.

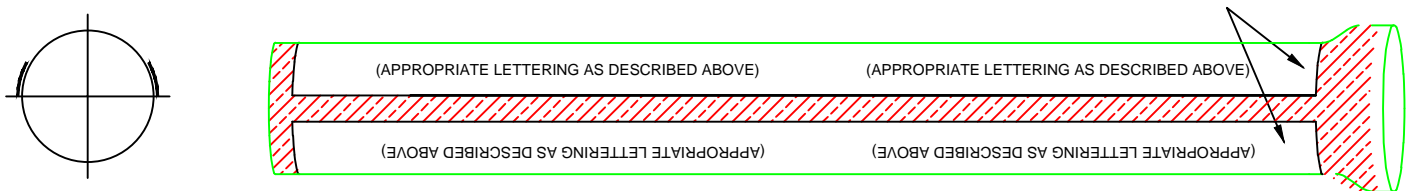

20" AND LARGER PIPE - 6" MIN TAPE IS PLACED ON BOTH SIDES OF THE TOP HALF OF THE PIPE WITH A THIRD STRIP CENTERED ALONG TOP HALF OF PIPE.

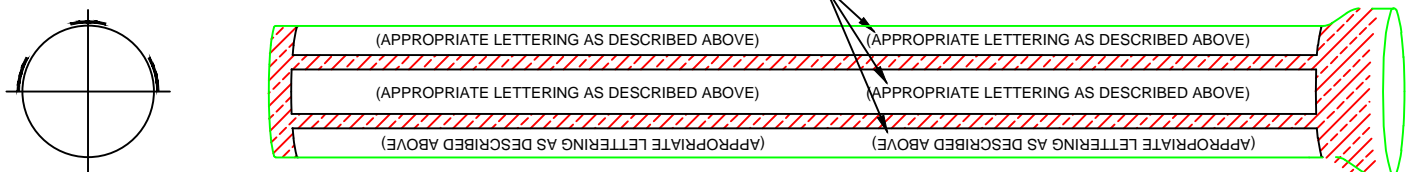

PURPLE TAPE WITH WHITE OR OTHER CONTRASTING PERMANENTLY IMPREGNATED LETTERING SHALL BE USED. THE TAPE SHALL RUN FROM JOINT TO JOINT ALONG THE LENGTH OF THE PIPE.

METAL RECLAIMED WATER MAIN WITH IDENTIFICATION TAPE

NTS



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

PIPE IDENTIFICATION

GU002-4

ISSUED 2017

REVISED 03/01/2017 BY DJB