


# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

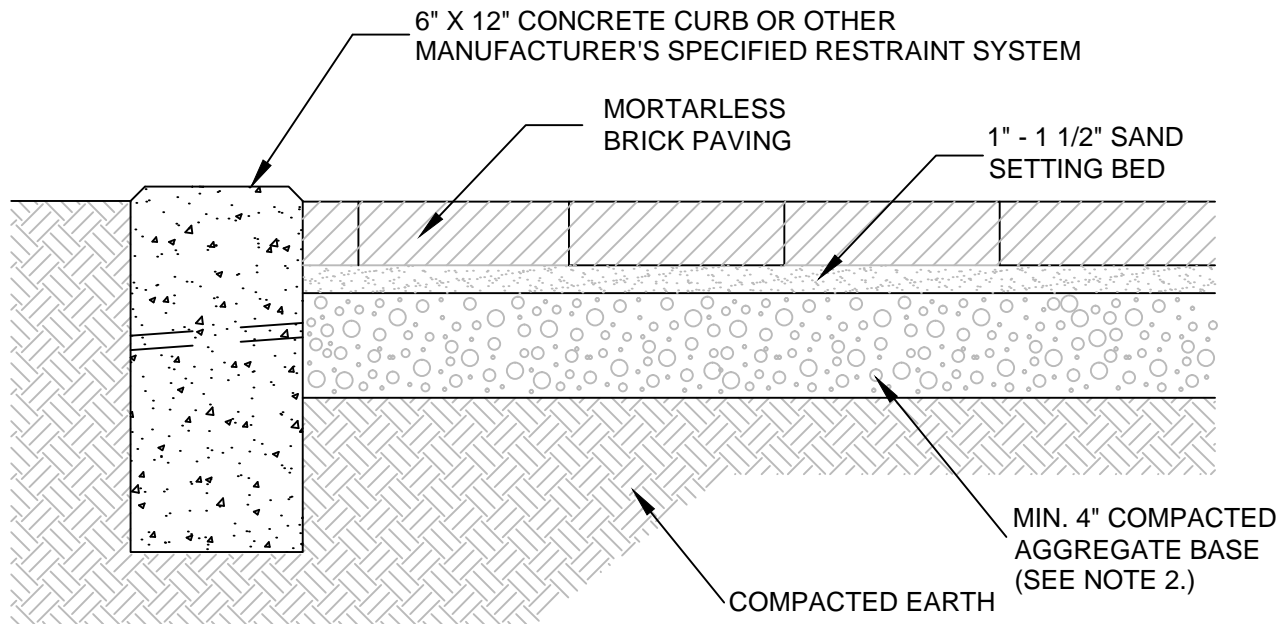

MORTARLESS BRICK PAVING

CONCRETE CURB EDGING

DRIVEWAY APRON

## NOTES:

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. A SUBGRADE CONSISTING OF GRADED AGGREGATES AND/OR GEOTEXTILE FABRIC MAY BE REQUIRED WHEN SUBGRADE CONDITIONS ARE POOR.
3. PAVEMENTS SUBJECTED TO VEHICULAR TRAFFIC MUST BE DESIGNED BY A PROFESSIONAL ENGINEER TO ACCOMMODATE WHEEL LOADS.
4. THE PAVING SYSTEM SHOULD BE SLOPED A MINIMUM OF 1/4" PER FOOT AWAY FROM BUILDINGS, RETAINING WALLS AND OTHER ELEMENTS CAPABLE OF COLLECTING OR RESTRICTING RUNOFF.



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## BRICK PAVING ASSEMBLIES

**MI018-0**

**ISSUED 2017**

REVISED 03/01/2017 BY DJB