


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

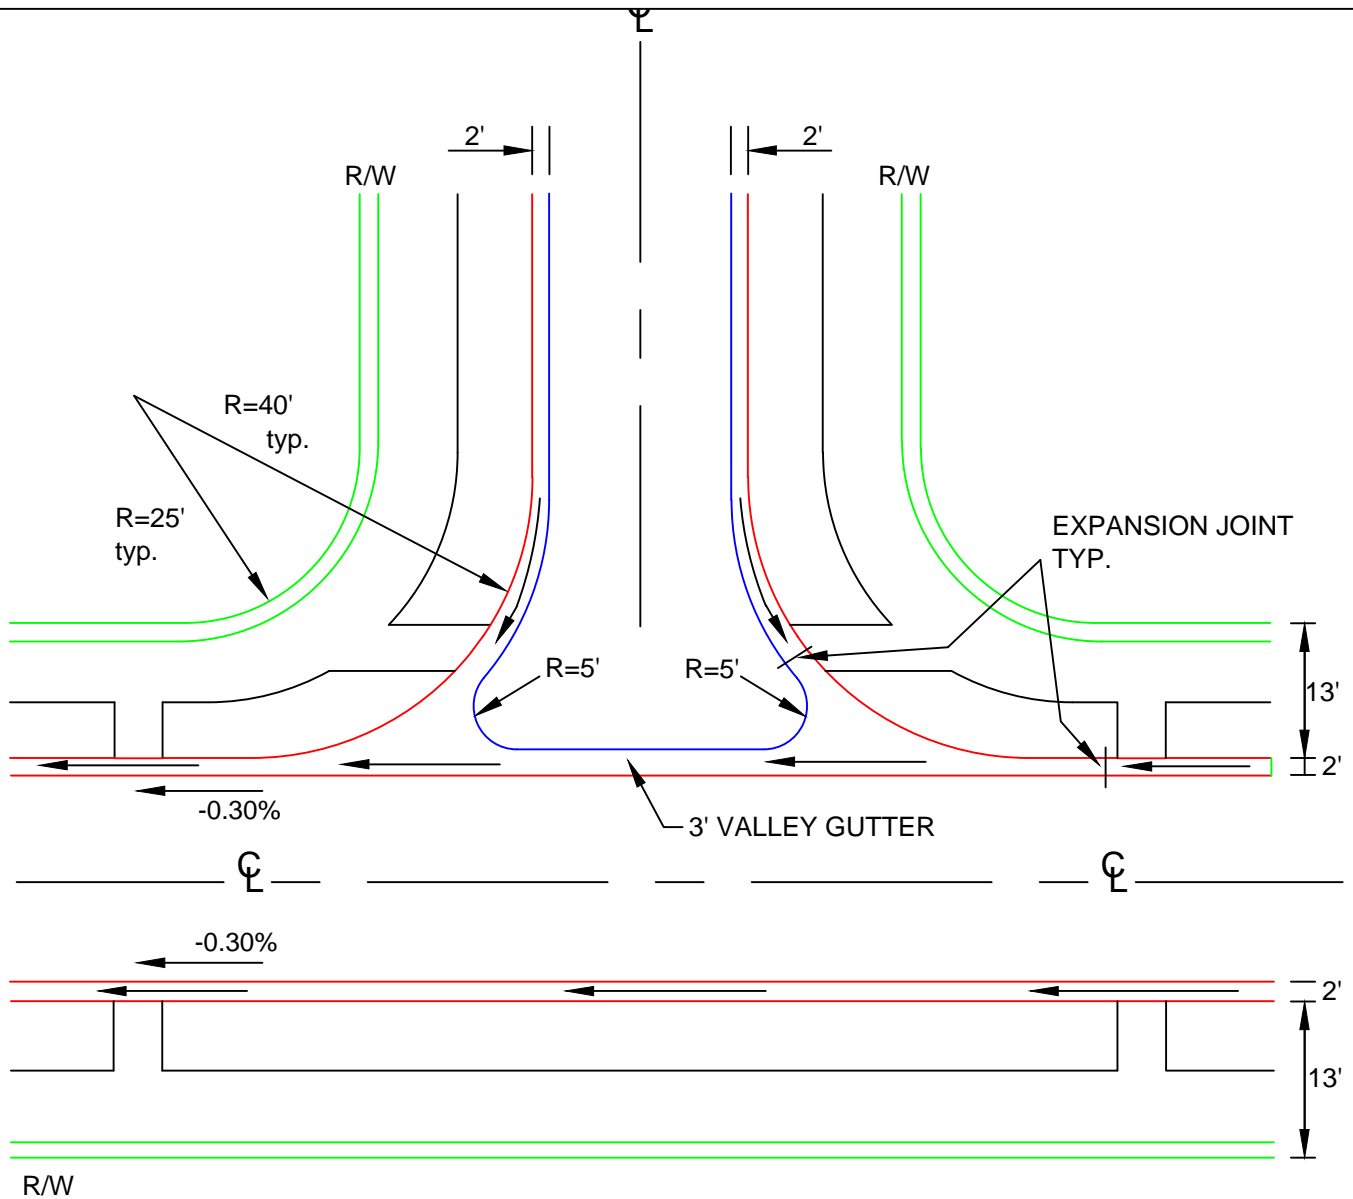

NOTES:

1. VALLEY GUTTER TO HAVE A STANDARD LONGITUDINAL SLOPE OF -0.30%
2. VALLEY GUTTER TO BE CONSTRUCTED OF 28 DAY, 3,000 P.S.I. CONCRETE
3. *SUB-BASE TO BE COMPACTED AND TESTED TO 98% MINIMUM DENSITY WITH MINIMUM L.B.R. 40 BASED ON AASHTO T-180 MODIFIED PROCTOR TEST, OR FBV 75 PSI.
4. VALLEY GUTTERS ARE REQUIRED WHEN STORM WATER CROSSES THE INTERSECTION.

* DEPTH OF SUB-BASE VARIES ACCORDING TO PLANS.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

ROADWAY VALLEY GUTTER

RD008-2

ISSUED 2017

REVISED 03/01/2017 BY DJB