


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS



- A CONNECTION TO UNDERGROUND IRRIGATION SYSTEM
- B LOCKABLE CURB STOP
- C CONTROL HANDLE - TURNS SYSTEM PRESSURE ON AND OFF (ATTACH HANDLE WHEN REQUIRED FOR USE ONLY)
- D QUICK DISCONNECT DEVICE (PROVIDED BY CITY) FITS MODIFIED 5/8" OR 3/4" GARDEN HOSE (DETACH WHEN NOT IN USE)
- E SERVICE CONNECTION IS CONTAINED IN A BOX LABELED "RECLAIMED WATER". BOX LID IS LEVEL WITH THE GROUND
- F SUPPORT STAKE WITH NYLON TIE WRAPS MUST BE INSTALLED TO PROVIDE SUPPORT TO VERTICAL ALIGNMENT OF SERVICE CONNECTION

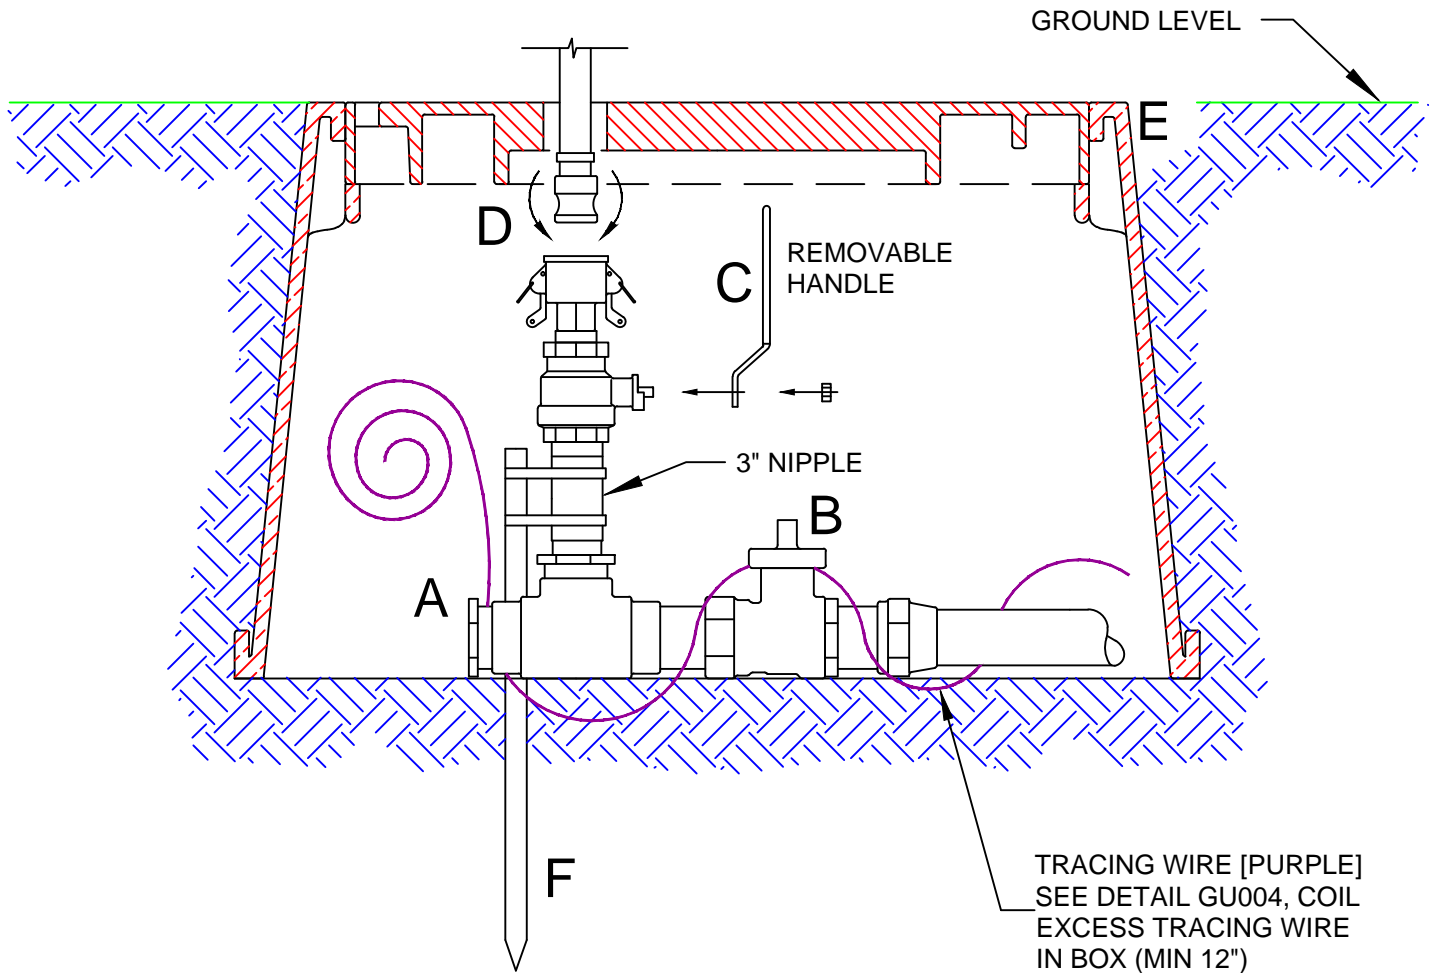

CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

RECLAIMED WATER - SERVICE CONNECTION BOX

RW004-2

ISSUED 2017

REVISED 03/01/2017 BY DJB