


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS



NOTES:

1. ALL VALVES SHALL BE FULL PORT.
2. * DENOTES BY OTHERS.

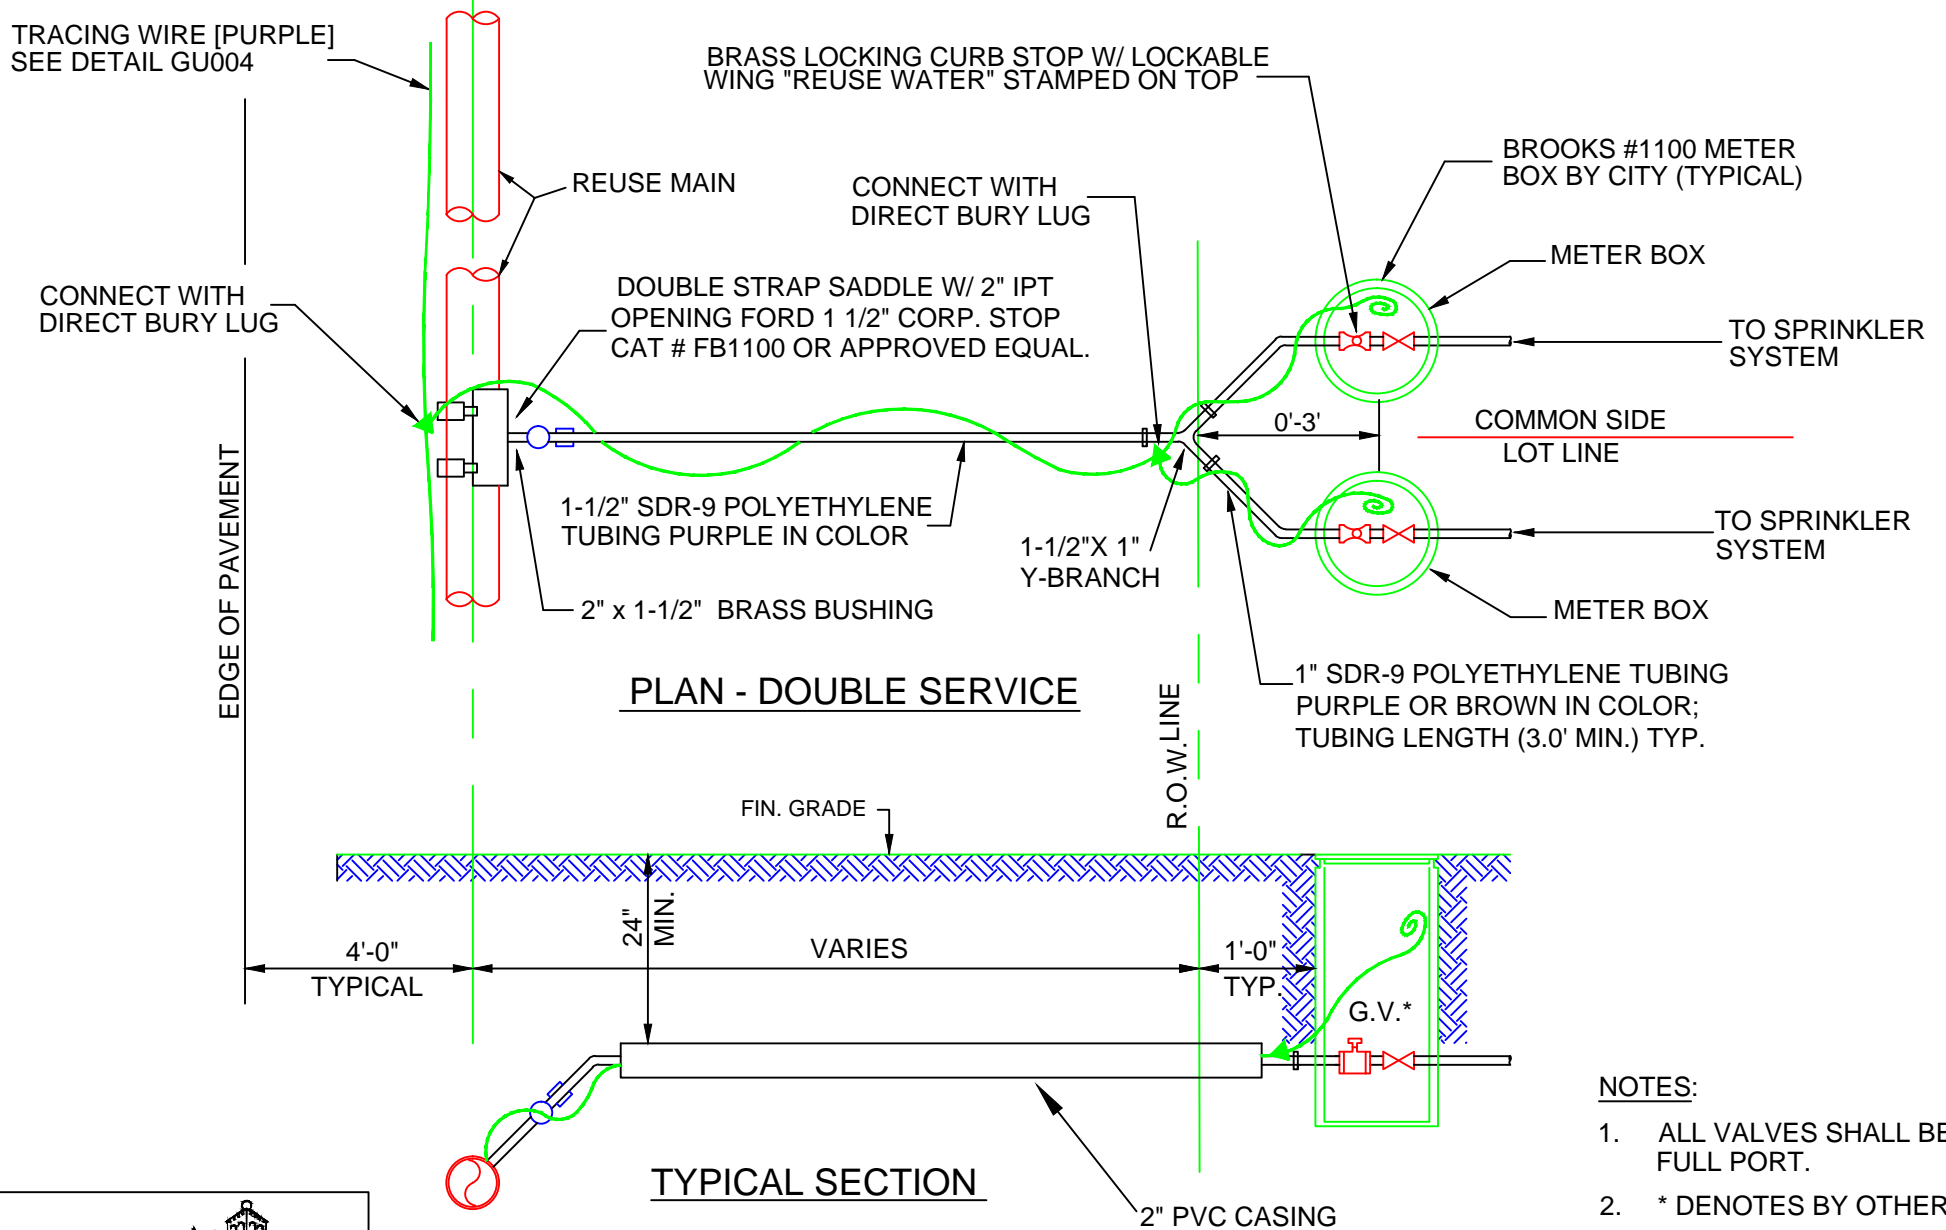

CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

RECLAIMED WATER - DOUBLE SERVICE CONNECTION

RW003-2

ISSUED 2017

REVISED 03/01/2017 BY DJB